


House Foundation

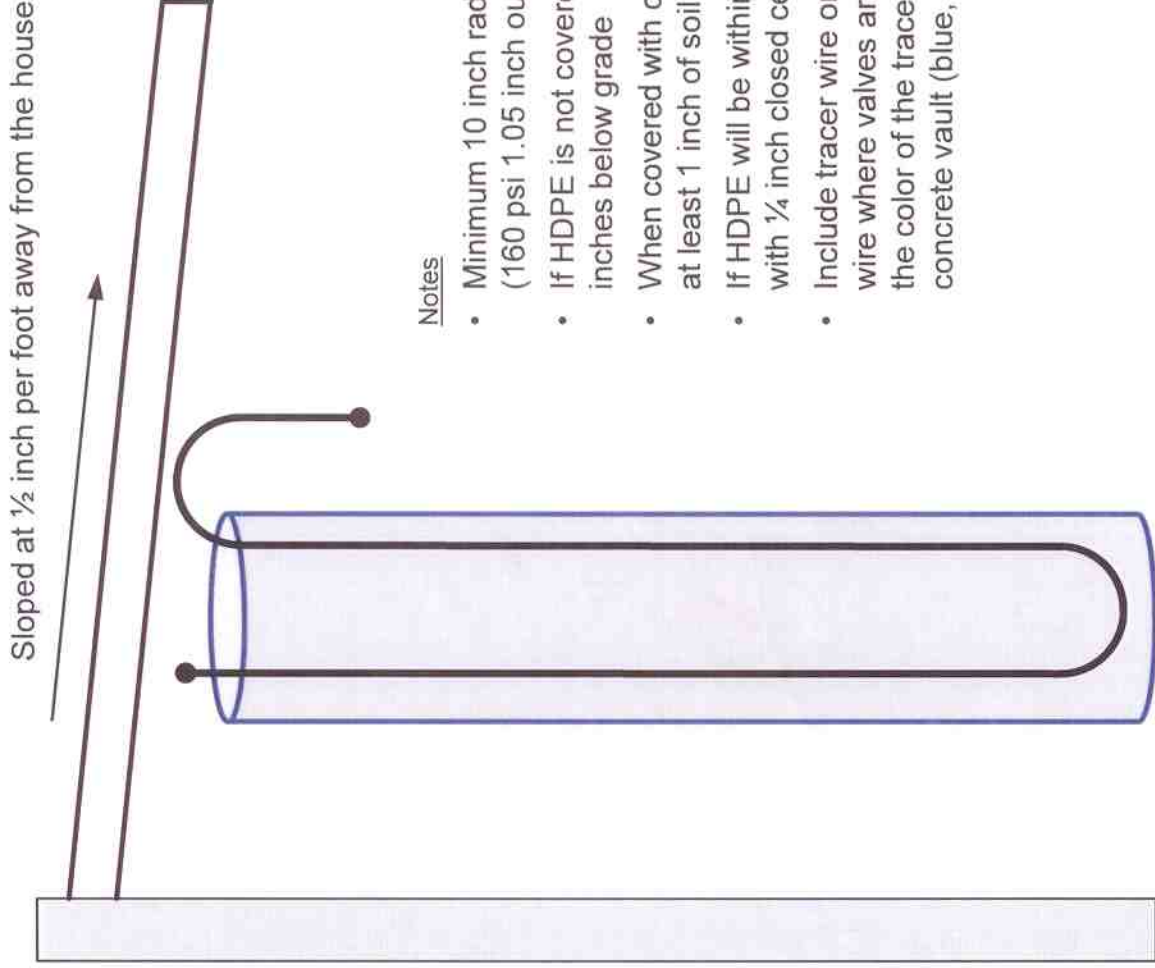

Concrete walkways around house to be 4 inches thick, sloped at 1/2 inch per foot away from the house

Notes

- Minimum 10 inch radius bend for 3/4 inch SDR 11 HDPE (160 psi 1.05 inch outside diameter)
- If HDPE is not covered with concrete then bury at least 18 inches below grade
- When covered with concrete, HDPE should be covered with at least 1 inch of soil
- If HDPE will be within 1 inch of concrete then wrap HDPE with 1/4 inch closed cell foam insulation
- Include tracer wire on all HDPE and terminate the tracer wire where valves are located (in the concrete vault), noting the color of the tracer wire at the termination points in the concrete vault (blue, yellow or otherwise)



Connecting Ground Loop in Concrete Piers

Mekechuk/Sinclair Residence

17509 Via Sereno, Monte Sereno, CA 95030

NTS

09/16/10

Detail

GL.6